



中国认可
检测
TESTING
CNAS L0599

第1页,共11页

检测报告

客户信息

联系人 Kimi SHI
客户 上海杨浦法国学校
地址 中国上海市杨浦区政悦路318号328室
电话 -
传真 -
Email kimi.shi@purelivingchina.com
订单号 -
样品 室内空气(13)
项目 -

实验室信息

管理者 SGS-CSTC
实验室 环境测试服务部
地址 上海市徐汇区宜山路889号3号楼2楼
电话 +86 (21) 6140 2666-2002
传真 +86 (21) 6115 2164
Email REPORT.ENV@SGS.COM
报告编号 SHE19-09144 R0
SGS编号 0000130895
报告日期 2019/09/05

备注

1. 结果适用于采样样品。

报告批准人

窦卓文

窦卓文
报告编制

周海燕

周海燕
审核

沈咏洁

沈咏洁
批准人



SGS-CSTC Standards Technical Services (Shanghai) Co., Ltd.
Testing Center-Environmental Laboratory

Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <http://www.sgs.com/en/Terms-and-Conditions.aspx> and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at <http://www.sgs.com/en/Terms-and-Conditions/Terms-e-Documents.aspx>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.

Attention: To check the authenticity of testing / inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: CN.Doccheck@sgs.com

3rd Building, No.889 Yishan Road, Xuhui District, Shanghai, China 200233

中国·上海·徐汇区宜山路889号3号楼

邮编: 200233

t (86-21) 61072828 f (86-21) 61152164

t (86-21) 61072828 f (86-21) 61152164

www.sgsgroup.com.cn

e sgs.china@sgs.com

Member of the SGS Group (SGS SA)

声明 Statement

1. 检测报告无本实验室检验检测专用章无效。

The test report is invalid without the official seal of the laboratory.

2. 未经本公司书面许可, 不得复制 (全文复制除外) 检测报告。

This test report cannot be reproduced in any way, except in full content, without prior approval in writing by the laboratory.

3. 检测报告无编制、审核、批准人签字无效。

The test report is invalid without the signature of the compiler, the checker and the approver

4. 检测报告涂改无效。

The test report is invalid if altered.

5. 本检测报告以中文为准, 英文文本 (如有) 仅为译文, 两者发生冲突时, 应以中文文本为准。

The test report has been drafted in Chinese and translated into English (if applicable) for convenience only. In the event of discrepancy, the Chinese version shall prevail.

符号表/Legend

NA 样品未测试该参数/The sample was not analysed for this analyte

↑ 提高检出限/Detection limit raised

↓ 降低检出限/Detection limit lowered

ND 未检出/Not Detected



Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <http://www.sgs.com/en/Terms-and-Conditions.aspx> and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at <http://www.sgs.com/en/Terms-and-Conditions/Terms-e-Documents.aspx>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.

Attention: To check the authenticity of testing /inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: CN.Doccheck@sgs.com

SGS-CSTC Standards Technical Services (Shanghai) Co., Ltd.
Testing Center-Environmental Laboratory.

3rd Building, No.889 Yishan Road, Xuhui District, Shanghai, China 200233
中国·上海·徐汇区宜山路889号3号楼 邮编: 200233

t (86-21) 61072828 f (86-21) 61152164
t (86-21) 61072828 f (86-21) 61152164

www.sgsgroup.com.cn
e sgs.china@sgs.com

					实验室编号 样品性状 样品描述	19-09144.001 室内空气 -	19-09144.002 室内空气 -	19-09144.003 室内空气 -
分析指标	方法	单位	检出限	限值				
采样位置	-	-	-	-	5# 507	5# 506	2# 227	
采样日期	-	-	-	-	2019/8/30	2019/8/30	2019/8/30	
采样时间(氨)	-	-	-	-	10:30-10:40	10:31-10:41	11:12-11:22	
采样时间(氧)	-	-	-	-	10:30-10:50	10:31-10:51	11:07-11:27	
采样时间(其他)	-	-	-	-	10:30-10:50	10:31-10:51	11:12-11:32	
环境温度	-	°C	-	-	24.6	24.7	23.1	
环境湿度	-	%	-	-	57.3	57.6	59.9	
大气压	-	kPa	-	-	101.0	101.0	101.2	
氧	GB 50325	Bq/m ³	4	≤200	11	14	4	
氨	GB/T18204.2	mg/m ³	0.01	≤0.2	<0.01	<0.01	<0.01	
甲醛	GB/T18204.2	mg/m ³	0.01	≤0.08	0.01	0.04	0.01	
苯	GB 50325	mg/m ³	0.01	≤0.09	<0.01	0.01	<0.01	
总挥发性有机物	GB 50325	mg/m ³	0.050	≤0.5	0.102	0.162	0.099	



Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <http://www.sgs.com/en/Terms-and-Conditions.aspx> and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at <http://www.sgs.com/en/Terms-and-Conditions/Terms-e-Documents.aspx>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.

Attention: To check the authenticity of testing /inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: CN.Doccheck@sgs.com

SGS-CSTC Standards Technical Services (Shanghai) Co., Ltd.
Testing Center-Environmental Laboratory

3rd Building, No.889 Yishan Road, Xuhui District, Shanghai, China 200233
中国·上海·徐汇区宜山路889号3号楼 邮编: 200233

t (86-21) 61072828 f (86-21) 61152164 www.sgsgroup.com.cn
t (86-21) 61072828 f (86-21) 61152164 e sgs.china@sgs.com

					实验室编号 样品性状 样品描述	19-09144.004 室内空气 -	19-09144.005 室内空气 -	19-09144.006 室内空气 -
分析指标	方法	单位	检出限	限值				
采样位置	-	-	-	-	2# 232	2# 233	2# 235	
采样日期	-	-	-	-	2019/8/30	2019/8/30	2019/8/30	
采样时间(氨)	-	-	-	-	11:13-11:23	11:40-11:50	11:41-11:51	
采样时间(氨)	-	-	-	-	11:10-11:30	11:38-11:58	11:38-11:58	
采样时间(其他)	-	-	-	-	11:13-11:33	11:40-12:00	11:41-12:01	
环境温度	-	°C	-	-	23.2	23.2	23.7	
环境湿度	-	%	-	-	60.2	60.2	59.1	
大气压	-	kPa	-	-	101.2	101.2	101.2	
氨	GB 50325	Bq/m ³	4	≤200	9	8	12	
氡	GB/T18204.2	mg/m ³	0.01	≤0.2	0.04	<0.01	<0.01	
甲醛	GB/T18204.2	mg/m ³	0.01	≤0.08	0.01	0.01	0.02	
苯	GB 50325	mg/m ³	0.01	≤0.09	<0.01	<0.01	<0.01	
总挥发性有机物	GB 50325	mg/m ³	0.050	≤0.5	0.118	0.114	0.179	



Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <http://www.sgs.com/en/Terms-and-Conditions.aspx> and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at <http://www.sgs.com/en/Terms-and-Conditions/Terms-e-Documents.aspx>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.

Attention: To check the authenticity of testing /inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: CN.Doccheck@sgs.com

SGS-CTC (Shanghai) Technical Services (Shanghai) Co., Ltd.
Testing Center-Environmental Laboratory

3rd Building, No.889 Yishan Road, Xuhui District, Shanghai, China 200233
中国·上海·徐汇区宜山路889号3号楼 邮编: 200233

t (86-21) 61072828 f (86-21) 61152164 www.sgsgroup.com.cn
t (86-21) 61072828 f (86-21) 61152164 e sgs.china@sgs.com

实验室编号 样品性状 样品描述					19-09144.007 室内空气 -	19-09144.008 室内空气 -	19-09144.009 室内空气 -
分析指标	方法	单位	检出限	限值			
采样位置	-	-	-	-	2# 236	2# 246	2# 248
采样日期	-	-	-	-	2019/8/30	2019/8/30	2019/8/30
采样时间(氨)	-	-	-	-	12:34-12:44	12:36-12:46	13:03-13:13
采样时间(氨)	-	-	-	-	12:24-11:44	12:27-12:47	13:00-13:20
采样时间(其他)	-	-	-	-	12:34-12:54	12:36-12:56	13:03-13:23
环境温度	-	°C	-	-	23.9	23.7	22.7
环境湿度	-	%	-	-	60.0	59.1	62.6
大气压	-	kPa	-	-	101.1	101.1	101.1
氧	GB 50325	Bq/m ³	4	≤200	10	8	6
氨	GB/T18204.2	mg/m ³	0.01	≤0.2	0.09	<0.01	0.06
甲醛	GB/T18204.2	mg/m ³	0.01	≤0.08	0.02	0.01	<0.01
苯	GB 50325	mg/m ³	0.01	≤0.09	<0.01	<0.01	<0.01
总挥发性有机物	GB 50325	mg/m ³	0.050	≤0.5	0.188	0.121	0.088



Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <http://www.sgs.com/en/Terms-and-Conditions.aspx> and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at <http://www.sgs.com/en/Terms-and-Conditions/Terms-e-Documents.aspx>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.

Attention: To check the authenticity of testing / inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: CN.Doccheck@sgs.com

SGS-CSTC Standards Technical Services (Shanghai) Co., Ltd.
Testing Center-Environmental Laboratory.

3rd Building, No.889 Yishan Road, Xuhui District, Shanghai, China 200233
中国·上海·徐汇区宜山路889号3号楼 邮编: 200233

t (86-21) 61072828 f (86-21) 61152164 www.sgsgroup.com.cn
t (86-21) 61072828 f (86-21) 61152164 e sgs.china@sgs.com

实验室编号 样品性状 样品描述					19-09144.010 室内空气 -	19-09144.011 室内空气 -	19-09144.012 室内空气 -
分析指标	方法	单位	检出限	限值			
采样位置	-	-	-	-	2# 204	2# 203	2# 210
采样日期	-	-	-	-	2019/8/30	2019/8/30	2019/8/30
采样时间(氨)	-	-	-	-	13:04-13:14	13:30-13:40	13:31-13:41
采样时间(氨)	-	-	-	-	13:00-13:20	13:46-14:06	13:26-13:46
采样时间(其他)	-	-	-	-	13:04-13:24	13:30-13:50	13:31-13:51
环境温度	-	°C	-	-	23.3	24.1	23.9
环境湿度	-	%	-	-	62.4	64.5	63.3
大气压	-	kPa	-	-	101.1	101.1	101.1
氧	GB 50325	Bq/m ³	4	≤200	5	12	7
氨	GB/T18204.2	mg/m ³	0.01	≤0.2	<0.01	<0.01	<0.01
甲醛	GB/T18204.2	mg/m ³	0.01	≤0.08	0.02	<0.01	0.02
苯	GB 50325	mg/m ³	0.01	≤0.09	<0.01	<0.01	<0.01
总挥发性有机物	GB 50325	mg/m ³	0.050	≤0.5	0.223	0.149	0.083



Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <http://www.sgs.com/en/Terms-and-Conditions.aspx> and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at <http://www.sgs.com/en/Terms-and-Conditions/Terms-e-Documents.aspx>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.

Attention: To check the authenticity of testing /inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: CN.Doccheck@sgs.com

3rd Building, No.889 Yishan Road, Xuhui District, Shanghai, China 200233
中国·上海·徐汇区宜山路889号3号楼 邮编: 200233

t (86-21) 61072828 f (86-21) 61152164 www.sgsgroup.com.cn
t (86-21) 61072828 f (86-21) 61152164 e sgs.china@sgs.com

		实验室编号		19-09144.013	
		样品名称		OBK	
		样品性状		室内空气	
		样品描述		-	
分析指标	方法	单位	检出限	限值	
采样位置	-	-	-	-	室外空白
采样日期	-	-	-	-	2019/8/30
采样时间(氨)	-	-	-	-	14:35-14:45
采样时间(其他)	-	-	-	-	14:35-14:55
环境温度	-	°C	-	-	30.1
环境湿度	-	%	-	-	60.3
大气压	-	kPa	-	-	101.0
氨	GB/T18204.2	mg/m ³	0.01	≤0.2	0.10
甲醛	GB/T18204.2	mg/m ³	0.01	≤0.08	<0.01
苯	GB 50325	mg/m ³	0.01	≤0.09	<0.01
总挥发性有机物	GB 50325	mg/m ³	0.050	≤0.5	<0.050

备注:

采样地址:上海市殷行路江湾城路

限值: GB 50325-2010 《民用建筑工程室内环境污染控制规范》I

结果已扣除室外空白(除氨外)



Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <http://www.sgs.com/en/Terms-and-Conditions.aspx> and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at <http://www.sgs.com/en/Terms-and-Conditions/Terms-e-Documents.aspx>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.

Attention: To check the authenticity of testing / inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: CN.Doccheck@sgs.com

SGS-CSTC Standards Technical Services (Shanghai) Co., Ltd.
Testing Center-Environment Laboratory

3rd Building, No.889 Yishan Road, Xuhui District, Shanghai, China 200233

中国·上海·徐汇区宜山路889号3号楼 邮编: 200233

t (86-21) 61072828 f (86-21) 61152164

t (86-21) 61072828 f (86-21) 61152164

www.sgsgroup.com.cn

e sgs.china@sgs.com

方法列表

GB 50325-2010 民用建筑工程室内环境污染控制规范 直读法
 GB/T18204.2-2014 公共场所卫生检验方法 第2部分：化学污染物
 GB 50325-2010 民用建筑工程室内环境污染控制规范 附录F 气相色谱法
 GB 50325-2010 民用建筑工程室内环境污染控制规范 附录G 气相色谱法



Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <http://www.sgs.com/en/Terms-and-Conditions.aspx> and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at <http://www.sgs.com/en/Terms-and-Conditions/Terms-e-Documents.aspx>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.
Attention: To check the authenticity of testing /inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: CN.Doccheck@sgs.com
 3rd Building, No.889 Yishan Road, Xuhui District, Shanghai, China 200233 t (86-21) 61072828 f (86-21) 61152164 www.sgsgroup.com.cn
 中国·上海·徐汇区宜山路889号3号楼 邮编: 200233 t (86-21) 61072828 f (86-21) 61152164 e sgs.china@sgs.com

方法:采样仪器信息(Sampling equipment information)*

仪器名称	型号	仪器编号	出厂序号
防爆大气采样器	FCC-1500D	ENV1447-21	1809721
防爆大气采样器	FCC-1500D	ENV1447-28	1809728
防爆大气采样器	FCC-1500D	ENV1447-34	1809734
防爆大气采样器	FCC-1500D	ENV1447-37	1809739
防爆大气采样器	FCC-1500D	ENV1447-5	1805406
防爆大气采样器	FCC-1500D	ENV1447-52	1809754
防爆大气采样器	FCC-1500D	ENV1447-58	1809760
防爆大气采样器	FCC-1500D	ENV1447-60	1809762

方法:GB 50325-2010

仪器名称	型号	仪器编号	出厂序号
环境氡测量仪	FD216	ENV1446-1	180333
环境氡测量仪	FD216	ENV1446-2	180335

方法:GB/T18204.2-2014

仪器名称	型号	仪器编号	出厂序号
可见分光光度计	723	ENV421	J1605010

方法:GB/T18204.2-2014

仪器名称	型号	仪器编号	出厂序号
可见分光光度计	723	ENV421	J1605010

方法:GB 50325-2010

仪器名称	型号	仪器编号	出厂序号
气相色谱仪	浙江福立GC9790PLUS	ENV451	9790P1201

方法:GB 50325-2010

仪器名称	型号	仪器编号	出厂序号
气相色谱仪	浙江福立GC9790PLUS	ENV451	9790P1201



Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <http://www.sgs.com/en/Terms-and-Conditions.aspx> and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at <http://www.sgs.com/en/Terms-and-Conditions/Terms-e-Documents.aspx>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.


Attention: To check the authenticity of testing / inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: CN.Doccheck@sgs.com

SGS-CTC (Shanghai) Co., Ltd.
Testing Center-Environmental Laboratory

3rd Building, No.889 Yishan Road, Xuhui District, Shanghai, China 200233
中国·上海·徐汇区宜山路889号3号楼 邮编: 200233

t (86-21) 61072828 f (86-21) 61152164 www.sgsgroup.com.cn
t (86-21) 61072828 f (86-21) 61152164 e sgs.china@sgs.com

附图

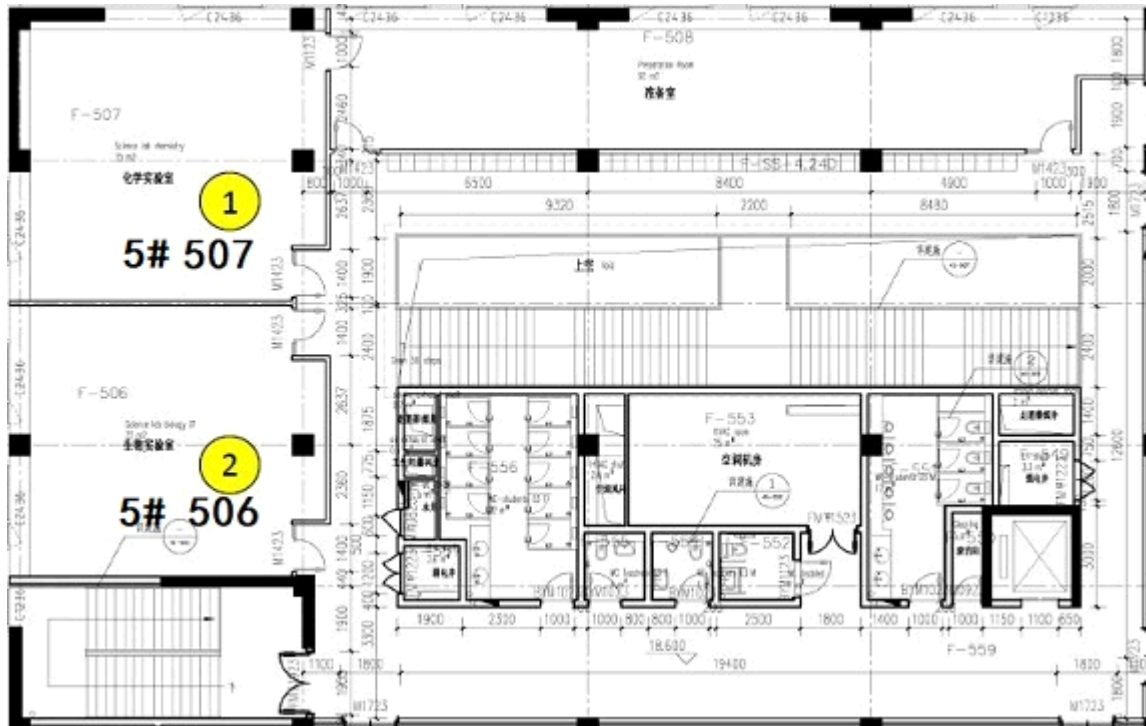

Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <http://www.sgs.com/en/Terms-and-Conditions.aspx> and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at <http://www.sgs.com/en/Terms-and-Conditions/Terms-e-Documents.aspx>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.

Attention: To check the authenticity of testing/inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: CN.Doccheck@sgs.com

SGS-CSTC Standards Technical Services (Shanghai) Co., Ltd.
Testing Center-Environmental Laboratory

3rd Building, No.889 Yishan Road, Xuhui District, Shanghai, China 200233


中国·上海·徐汇区宜山路889号3号楼 邮编: 200233

t (86-21) 61072828 f (86-21) 61152164

t (86-21) 61072828 f (86-21) 61152164

www.sgsgroup.com.cn

e sgs.china@sgs.com

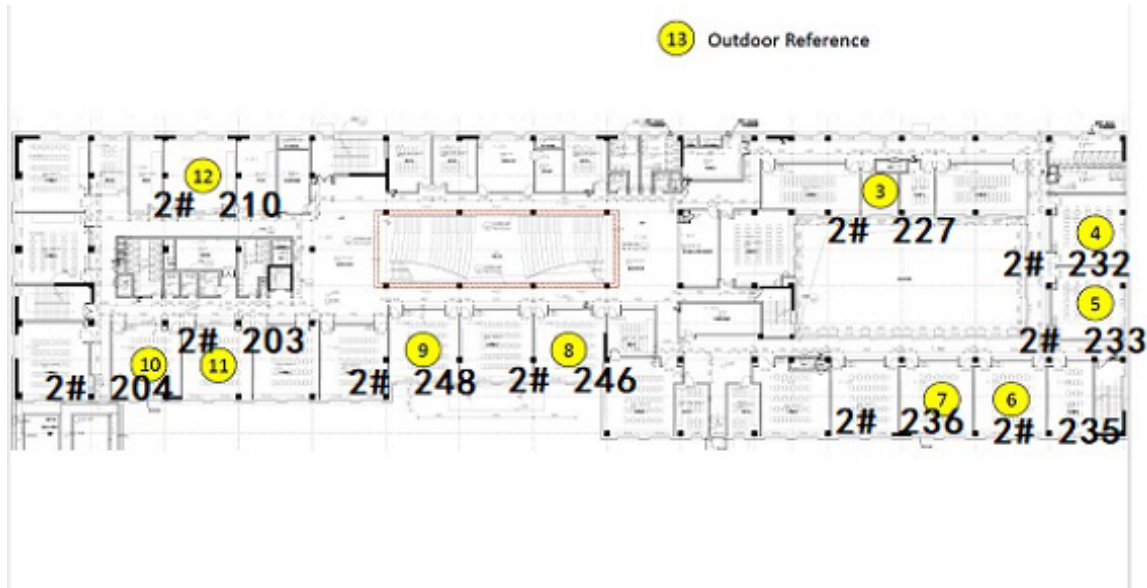

*** 以下空白 ***



Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <http://www.sgs.com/en/Terms-and-Conditions.aspx> and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at <http://www.sgs.com/en/Terms-and-Conditions/Terms-e-Documents.aspx>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.

Attention: To check the authenticity of testing / inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: CN.Doccheck@sgs.com

3rd Building, No.889 Yishan Road, Xuhui District, Shanghai, China 200233

中国·上海·徐汇区宜山路889号3号楼 邮编: 200233

t (86-21) 61072828 f (86-21) 61152164

t (86-21) 61072828 f (86-21) 61152164

www.sgsgroup.com.cn

e sgs.china@sgs.com